


CROSSING

LEGEND

D1 = 3' Min. for pipe < 12" dia
 D1 = 4' Min. for pipe ≥ 12" dia
 D2 = Minimum Cover
 W = Horizontal Separation

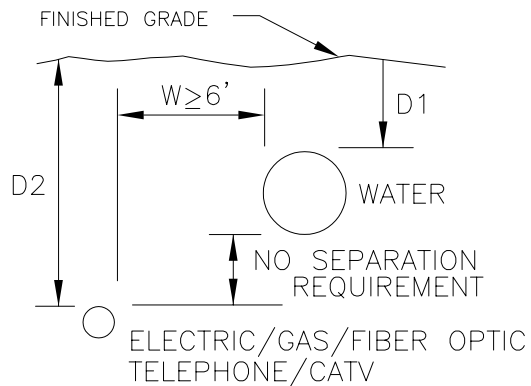

NOTES

1. Electric separation requirements are for primary electric conductors only. For service conductors see plans.
2. Primary electric, gas, telephone, cable TV or fiber optic lines shall not cross above a water line without written approval from the City's Utility Service Division. If this approval is obtained, a utility locator strip and ABC slurry.

DETAIL NO.
G-3300

CITY OF GOODYEAR
STANDARD DETAIL

APPROVED BY:
Goodyear Standards and
Policies Committee 7/97

MINIMUM UTILITY SEPARATION REQUIREMENTS

DETAIL NO.
G-3300